

PRODUCT INFORMATION & INSTALLATION GUIDE 2025

Airius Model 100/EC Standard Series EX-A-100-EC-STD-200-277



www.airius.co.uk



Product Information & Installation Guide STANDARD SERIES - Model 100/EC

MODEL 100/EC DIMENSIONS AND PROPERTIES



COVERAGE	Heating	Cooling
Nozzle Height =	Up to 32 m (105 ft) Up to 30.5 m (100 ft) Up to 232 m ² (2500 ft ²)	1 1 1 1 1 1

All data is indicative only and can change subject to application. For more accurate design please contact Airius.

MOTOR

Single Phase

Electrically commutated, variable speed 92% efficient motor

German EBM Papst EC motor

230 Volt @ 50/60 Hz

OPERATING TEMPERATURES

Operating Temperature Thermal Cut Off = -25°C (-13°F) to 60°C (140°F) = 60°C (140°F)

Following thermal cut off unit must be power cycled to reset

HOUSING

PC/ABS Resin - Inc. internal fixed blade stator, nozzle and cowl

5VA flame resistance rating

1.8 m steel safety leash cable (fastened to housing)

Applicable to Titan Series Upgrade - Chemical resistant ABS resin housing and stator blades with stainless steel fixings

INGRESS PROTECTION

IP54 Rated

UNIT SIZE

Weight: Height to Rim: Total Height: Diameter:

MOTOR

Watts*:	
RPM*:	
L/S*:	
m³/hr:	
Centre Line Velocity ¹ :	
AMPS*:	

20.4 kgs (45 lbs) N/A 843 mm (33.1 in) 495 mm (19.4 in)

STANDARD

230V @ 50 Hz

390 1690 812 (1722 CFM) 2925 0.71 m/s @ 30 m 2.50

*Motor data provided by motor manufacturer and is subject to change at anytime ¹Velocity profile tested in situ

NOISE LEVELS

Sound Pressure Level

= 40.7 dB(A)

Calculated from nozzle of unit to head height when installed at maximum ceiling height

For additional noise level information contact Airius

COLOUR

Cool gray 2C - Off white as standard

Can be tailor painted to your colour specifications

Titan Series Upgrade - Off white as standard

ACCESSORIES & OPTIONS

Optional speed controls allow for variable output from Airius unit.

EC controls available

Fully BMS controllable

Bacnet Protocol for individual fan control

For horizontal installations Airius recommend the use of a cradle, a second cable or a rod attachment to support the fan nozzle


WARRANTY

5 years parts and workmanship from shipping date 120 day money back guarantee (T's & C's apply)



Product Information & Installation Guide STANDARD SERIES - Model 100/EC

VELOCITY PROFILE

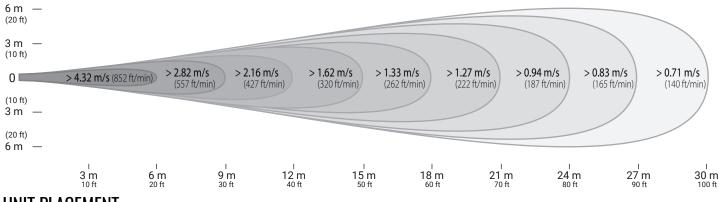

UNIT PLACEMENT

PREPARATION

Install electrical circuit(s) and outlet(s) in accordance with national and local electric codes.

Outlets should generally be mounted vertically unless a "twist/locking" type is being used.

Wall switch may be installed in circuit to disable power and prevent electrical hazards when servicing.

Confirm electrical continuity of Airius unit on the ground before permanently mounting in the ceiling.

MAINTENANCE

Frequency of cleaning will vary by application and environment.

You may clean the plastic housing with a damp warm cloth, using mild household detergents.

Do not use petroleum products, thinners or solvents to clean any part of the Airius unit.

If the Airius unit fails, contact manufacturer.

MATERIALS & PROPERTIES

Constructed from recyclable materials.

The outer shell, stator and fan blades are fire rated 5VA materials.

Power cord is a 1.8 m, 3 wire, 1.02 mm diameter 300VAC rated electrical cord - CE/EU compliance rated as HO5VV (PLUG NOT SUPPLIED).

Electrically commutated, variable speed 92% efficient motor.

Motor is thermally protected. Shutoff is at 135°C & reset is at 125°C.

No lubrication required. Bearings are sealed.

OPERATION

Designed to operate 24 hours-a-day, 7 days-a-week to maintain air circulation/thermal equalization/humidity equalization.

Use optional speed control to fine tune RPM if needed.

INSTALLATION

Do not hard connect fans in excess of 10 kgs unless agreed with Airius prior to Installation. When attaching it is preferred if some chain or cable is used between fan and the support. However it is not imperative.

Hang from the ceiling, typically 300 mm (12") - 450 mm (18") from the roof deck to fan intake.

For cooling applications fans can be installed slightly lower. Contact Airius for design details and assistance.

The Airius unit performs best when air column from the nozzle is unimpeded to the floor.

The Airius unit should not be mounted directly in front of heat ducts, vents or any other high heat source.

Use professionally installed hardware, capable of supporting a minimum of five times the weight of the fan unit.

Hardware to hang the unit includes but is not restricted to: Hooks, chains, cables, carabiners, bridle rings, beam clamps and bolts.

Density of the placement is directly related to the effectiveness, performance and savings.

Mount out of reach from people and animals.

Floor plans, mezzanines, office locations, machinery, people placement, plumbing, lighting, duct work, electrical systems, natural light/air systems, cranes, doors, windows, ventilation and fire suppression systems are all factors in properly locating the Airius system within the ceiling.


PLUG NOT SUPPLIED

Product Information & Installation Guide STANDARD SERIES - Model 100/EC


CHAIN HUNG (STRAIGHT)

To Control Module Safety chain/ Unistrut or Ceiling Beam cable secured 6 Cord Secured Receptacle Rated Chains should be rated @ 102 Kgs each 240 VAC (Not supplied). Cable Tie 240 v Plug • Chains can be attached using caribiners, Intake (single phase) bolts, Chemsets or Dyna Bolts. 300 VAC Rated Cord Furnished 2 m Safety chain/cable secured to leash anchor point Leash Anchor Point Unit Control Data Cable The leash anchor point acts as an additional Connected To Controller safety point when installed. It features a removable torx head screw that can be attached to a back up chain or cable (rated @ 90 kgs). Airius Air Circulation & Destratification Fan 0

CHAIN HUNG (ANGLED)

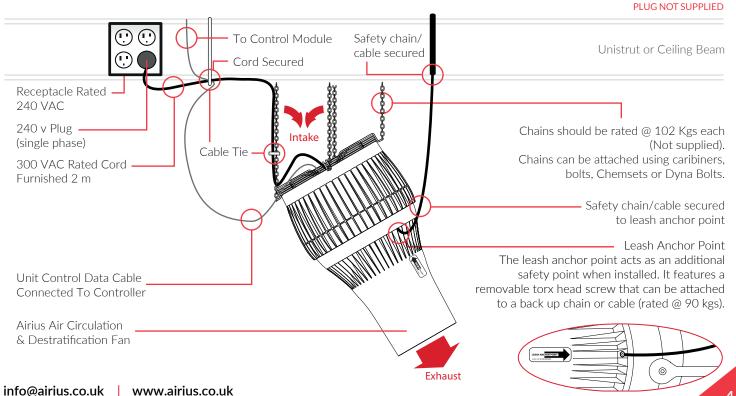

BMS CONTROL WIRING

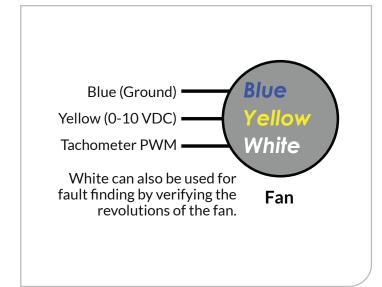

GENERAL NOTES


0-10 V signal allows infinitely variable open loop speed control

Connecting the red and yellow leads will allow EC fans to operate at full speed

A single controller can be used to control multiple fans with the same speed setting

The BMS generates this voltage to send to the signal (yellow)

Yellow is labelled as 0-10VDC because that is the acceptable range of voltages that the fan will accept

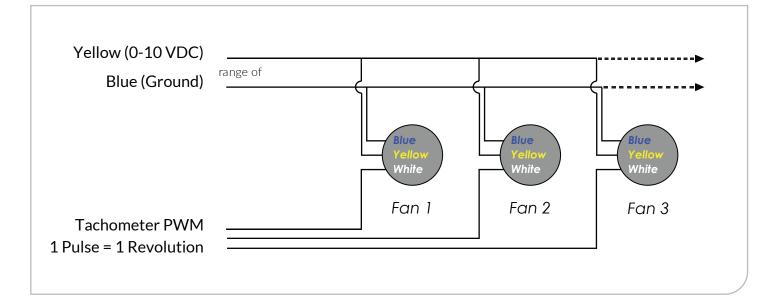



Airius Europe, Middle East & Asia

Airius Europe Ltd Holwell Farm, Cranborne Dorset BH21 5QP, UK Tel - +44 (0) 1202 554200 Email - info@airius.co.uk Web - www.airius.co.uk

Airius Americas

Email - Info@airiusfans.com Web - www.airiusfans.com

Airius Oceania & S.E. Asia

Email - info@airius.com.au Web - www.airius.com.au

USA and foreign Patents granted to AIRIUS LLC, USA, further patents pending. AIRIUS & AIRIUS SYSTEMS is the copyright property of AIRIUS LLC, USA. All material issued by, or emanating from, Airius Europe Ltd is the Copyright property of Airius Europe Ltd, UK.

