



## AIRIUS CEILING KIT MOUNTING GUIDELINES - PUREAIR PHI SERIES (SUSPENDED) - Model 45 - Option 1

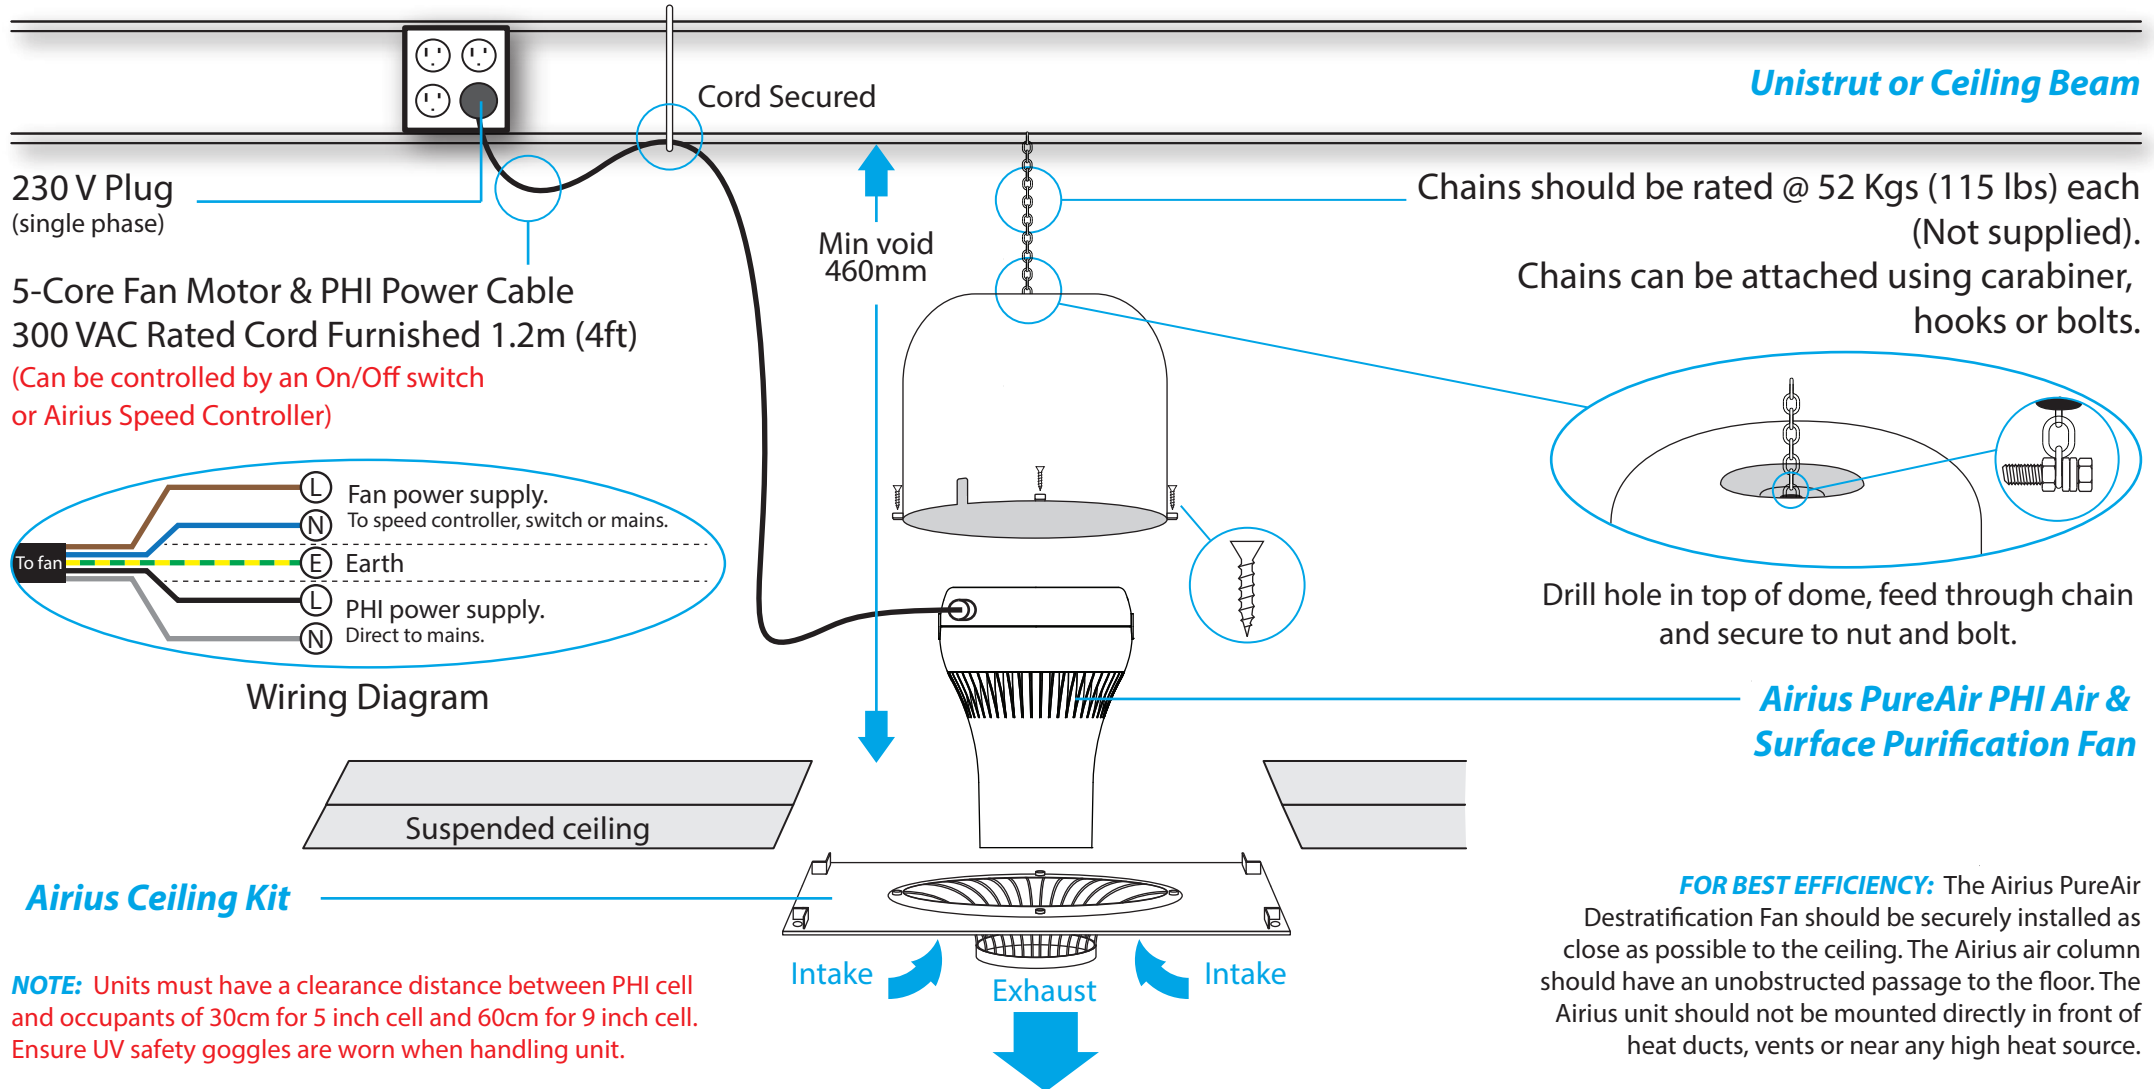

## AIRIUS CEILING KIT MOUNTING GUIDELINES - PUREAIR PHI SERIES (SUSPENDED) - Model 45 - Option 2

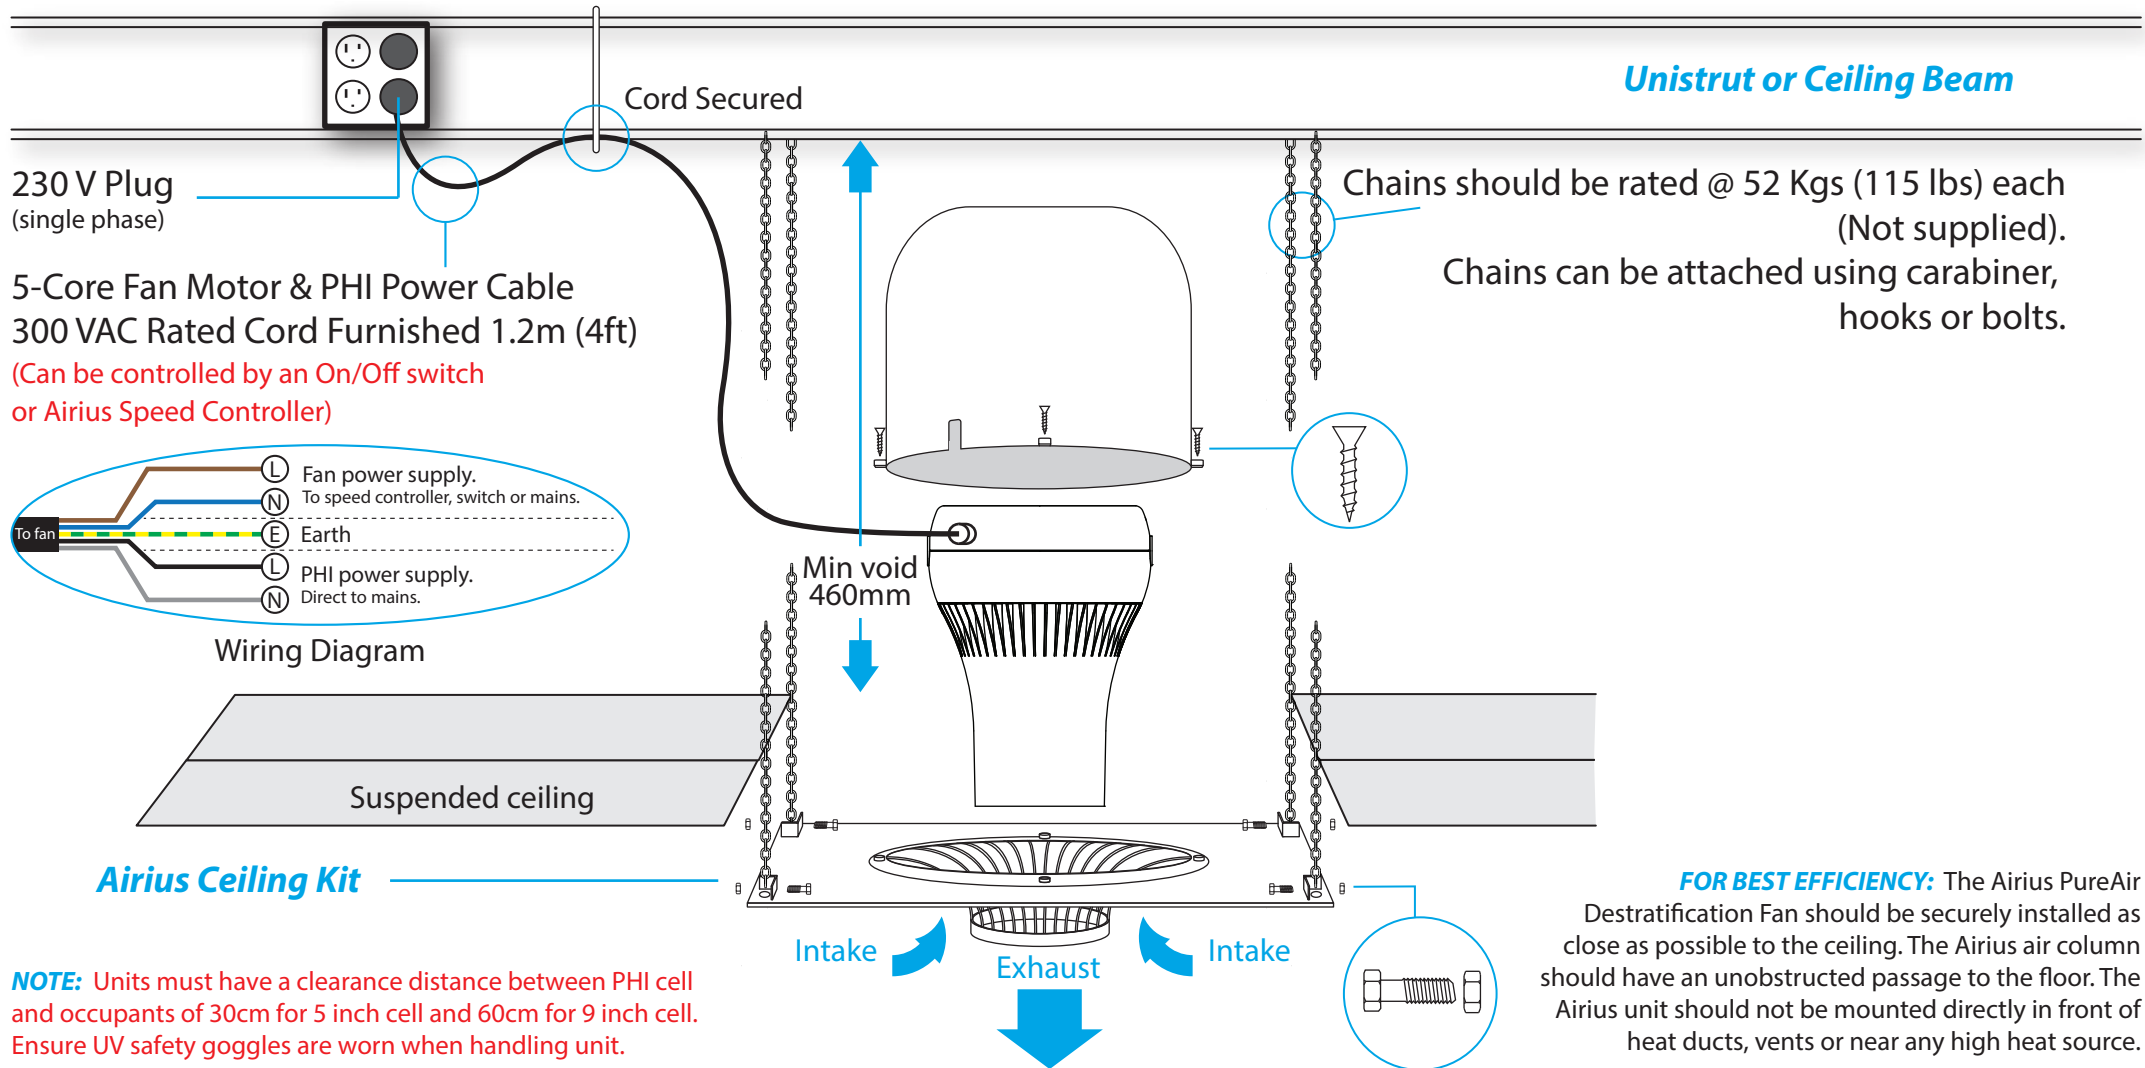

**NOTE:** Units must have a clearance distance between PHI cell and occupants of 30cm for 5 inch cell and 60cm for 9 inch cell. Ensure UV safety goggles are worn when handling unit.